



Nivoode arvutis uurimisest (Spectrum Lab v 2.82)

2015.07.26

- 1) Technics SL-Q2 / The Ultimate Analgue Test LP Track 1 => 1 kHz reference / Technics U-25 helipea

DMM: 250 mV AC



Spectrum Lab: -15 dB

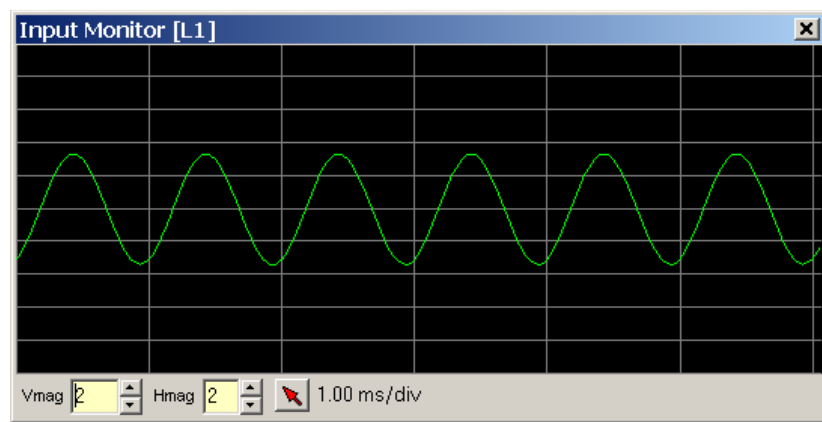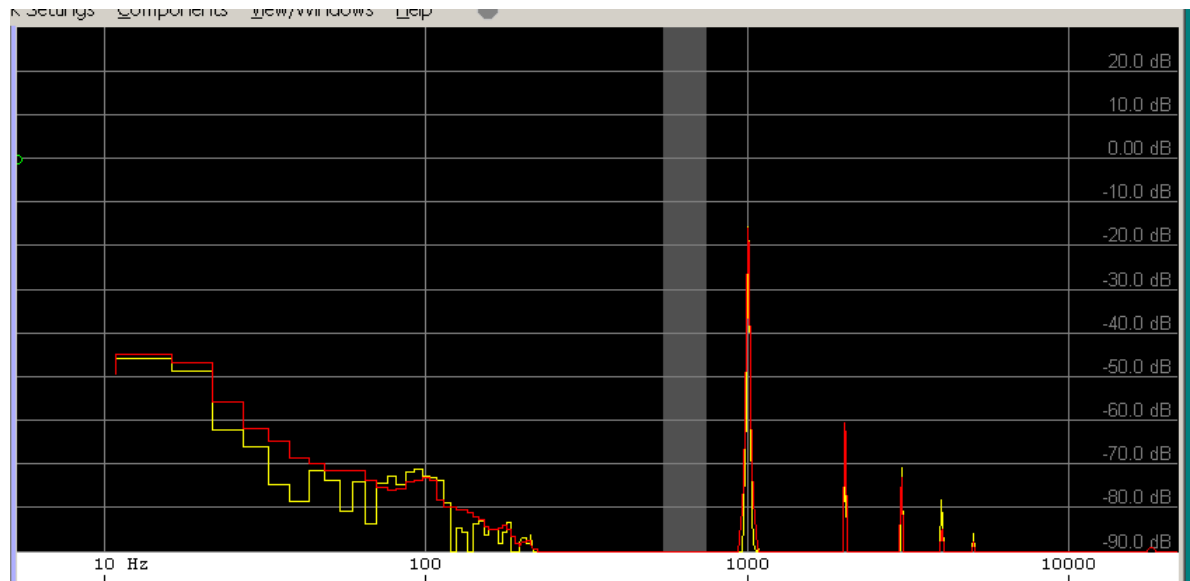

- 2) Technics SL-Q2 / The Ultimate Analgue Test LP Track 1 => 1 kHz reference / Ortofon M2 Blue helipea:

DMM: 390 mV AC


Spectrum Lab: -10 dB

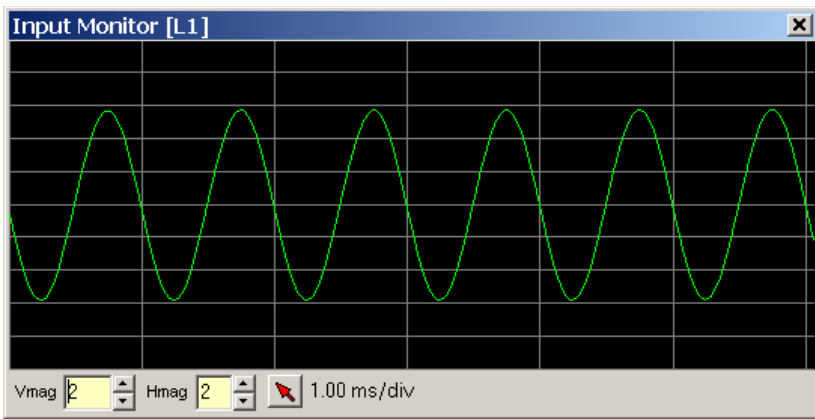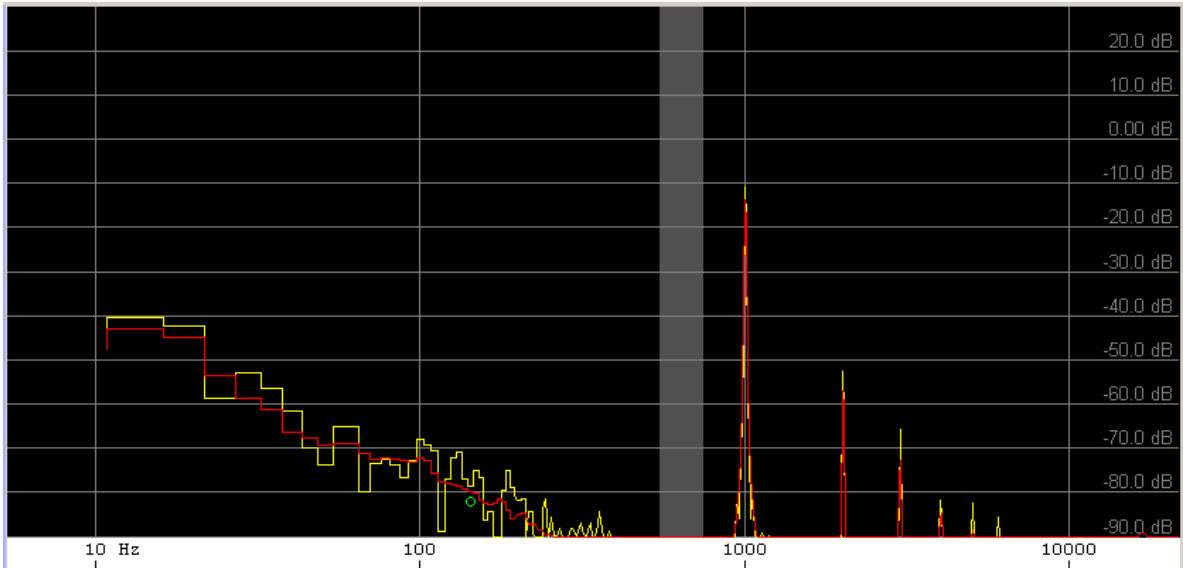


3) Marantz CD-67 (27k/5,6k attenuaatori väljund) / „1 kHz Audacity 0,8 vol level“ :

DMM: 300 mV AC

Spectrum Lab: -20 dB


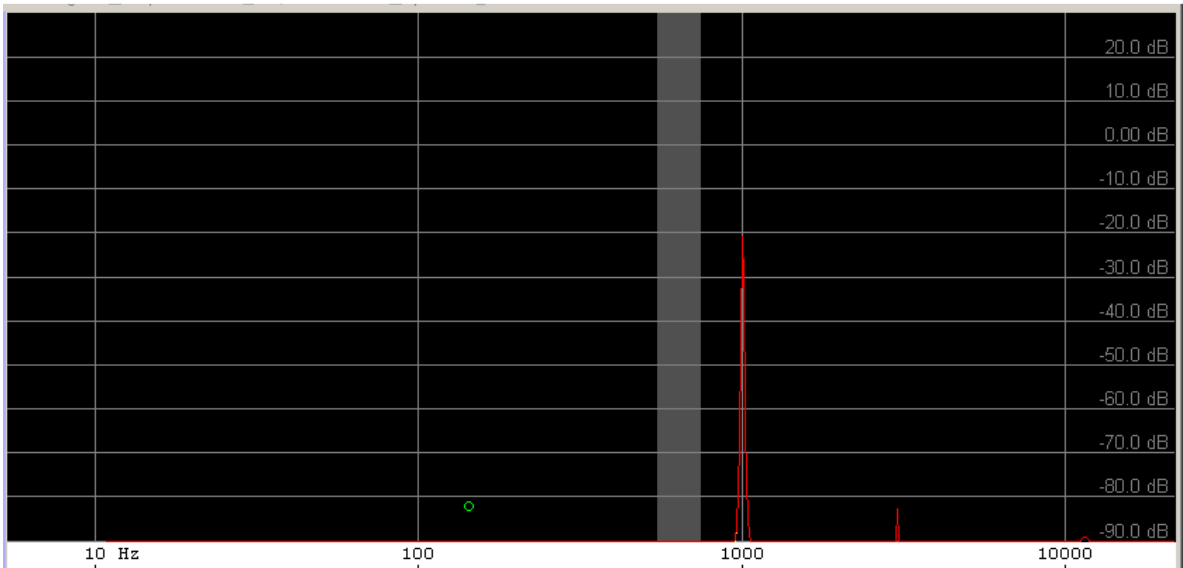


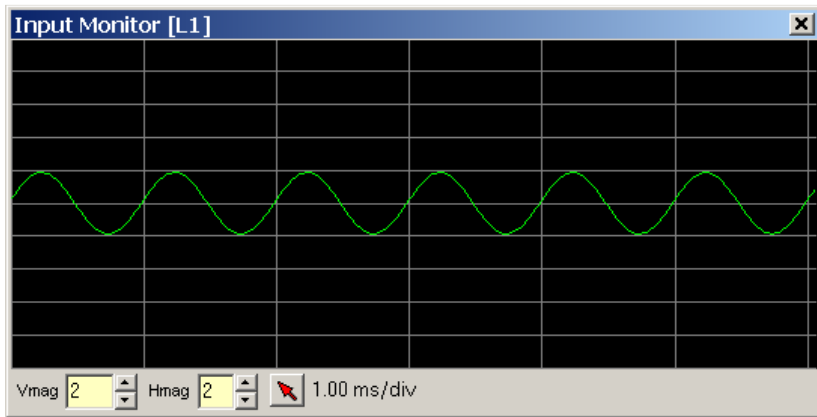

4) Marantz CD-67 (otseväljund) / „1 kHz Audacity 0,8 vol level“ :

DMM: 1,77 V AC

Spectrum Lab: -3 dB

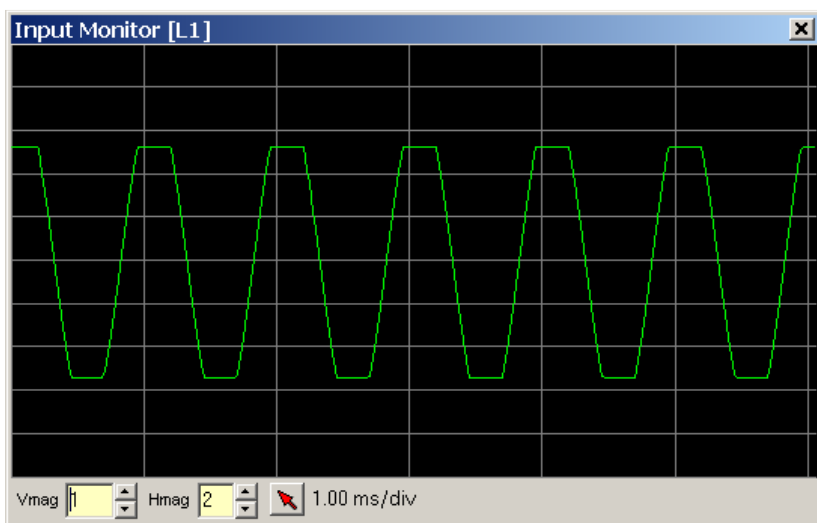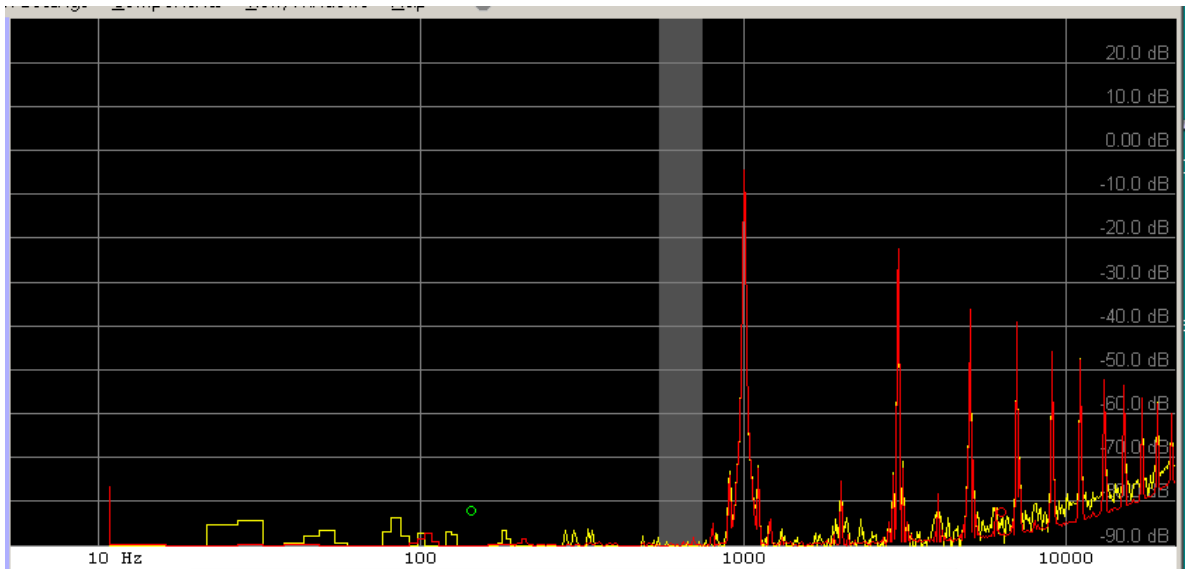

Ostilloskoobiga mõõtes on signaal ilus.